


BACnet PICS CIM 500

Protocol Implementation Conformance Statement
for Grundfos CIM 500 BACnet IP for Grundfos pumps, booster systems and
Grundfos Level Control LC 2X1 and LC 2X2

Installation and operating instructions, supplement

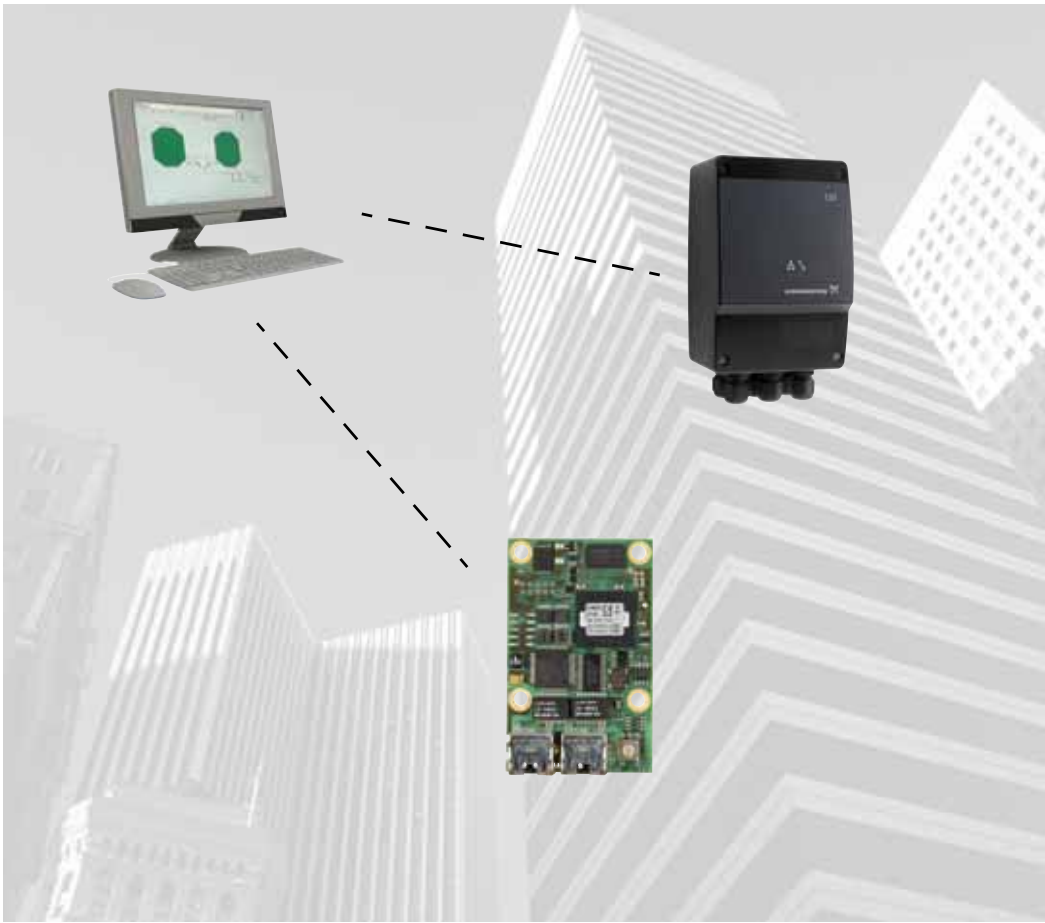

23English (GB) Functional profile and user manual

Original installation and operating instructions

CONTENTS

	Page
1. General information	2
1.1 Hazard statements	2
1.2 Notes	2
2. Product description	3
3. Supported BACnet Interoperability Building Blocks	3
3.1 Data Link Layer options	3
3.2 Device address binding	3
3.3 Networking options	3
3.4 Character sets supported	4
3.5 Non-BACnet equipment supported	4
4. Complete object list	5
4.1 Complete object list for pumps	5
4.2 Complete object list for booster systems	10
4.3 Complete object list for Level Control LC 2X1	20
4.4 Complete object list for Level Control LC 2X2	24

1. General information

1.1 Hazard statements

The symbols and hazard statements below may appear in Grundfos installation and operating instructions, safety instructions and service instructions.



DANGER

Indicates a hazardous situation which, if not avoided, will result in death or serious personal injury.



WARNING

Indicates a hazardous situation which, if not avoided, could result in death or serious personal injury.



CAUTION

Indicates a hazardous situation which, if not avoided, could result in minor or moderate personal injury.

The hazard statements are structured in the following way:



SIGNAL WORD

Description of hazard

Consequence of ignoring the warning.
- Action to avoid the hazard.

1.2 Notes

The symbols and notes below may appear in Grundfos installation and operating instructions, safety instructions and service instructions.



Observe these instructions for explosion-proof products.



A blue or grey circle with a white graphical symbol indicates that an action must be taken.



A red or grey circle with a diagonal bar, possibly with a black graphical symbol, indicates that an action must not be taken or must be stopped.



If these instructions are not observed, it may result in malfunction or damage to the equipment.



Tips and advice that make the work easier.



Fig. 1 The CIM 500 BACnet IP passed the BTL test in April 2014

Grundfos CIM 500 BACnet IP for pumps

Document date: 20.02.2020

Vendor name: Grundfos

Product name: CIM

Product model number: 500 BACnet IP

Application software: V06.16

Firmware revision: V06.16

BACnet protocol rev: 9

2. Product description

The CIM 500 BACnet IP interface from Grundfos enables BACnet communication with Grundfos pumps and systems that have a GENibus interface. The communication interface module can either be installed directly in the Grundfos pump/system to enable BACnet IP communication, or in an external power supply unit (CIU unit) connected to the pump/system. In both cases, the communication interface module is the same.

CIM 500 BACnet IP passed the BTL test in April 2014.

BACnet Standardised Device Profile (Annex L)

- ☐ BACnet Operator Workstation (B-OWS)
- ☐ BACnet Building Controller (B-BC)
- ☐ BACnet Advanced Application Controller (B-AAC)
- ☒ BACnet Application Specific Controller (B-ASC)
- ☐ BACnet Smart Sensor (B-SS)
- ☐ BACnet Smart Actuator (B-SA)

3. Supported BACnet Interoperability Building Blocks

Data sharing services:

Name	BACnet BIBB
ReadProperty	DS-RP-B
ReadPropertyMultiple	DS-RPM-B
WriteProperty	DS-WP-B
WritePropertyMultiple	DS-WPM-B
SubscribeCOV	DS-COV-B
ConfirmedCOVNotification	
UnconfirmedCOVNotification	

Device management services:

Name	BACnet BIBB
Who-is/I-am	DM-DDB-A
	DM-DDB-B
Who-has/I-have	DM-DOB-B
DeviceCommunicationControl	DM-DCC-B

Segmentation capability

- ☐ Segmented requests supported
Window Size_____
- ☐ Segmented responses supported
Window Size_____

Note Segmentation is not supported.

Object type	Supported	Dynamically creatable/deletable
Analog input	●	-
Analog output	●	-
Analog value	●	-
Binary input	●	-
Binary output	●	-
Multistate input	●	-
Multistate output	●	-
Device	●	-

3.1 Data Link Layer options

BACnet IP (Annex J).

3.2 Device address binding

The device does not support static device binding.

3.3 Networking options

- ☐ Router, Clause 6 - List all routing configurations, e.g. ARCNET-Ethernet, Ethernet-MS/TP, etc.
- ☐ Annex H, BACnet Tunneling Router over IP
- ☐ BACnet/IP Broadcast Management Device (BBMD)

Does the BBMD support registrations by foreign devices? ☒ Yes ☐ No

3.4 Character sets supported

Indicating support for multiple character sets does not imply that they can all be supported simultaneously.

Character set	Supported
ANSI X3.4	•
ISO 10646 (UCS-2)	-
ISO 10646 (UCS-4)	-
IBM™ / Microsoft™ DBCS	-
ISO 8859-1	-
JIS C 6226	-
UTF-8	•

3.5 Non-BACnet equipment supported

Types of non-BACnet equipment supported:

- Grundfos MAGNA circulator pumps*
 - Grundfos MAGNA3 circulator pumps
 - Grundfos UPE Series 2000 (UPE 80-120 and 100-120) circulator pumps
 - Grundfos CRE, CRNE, CRIE, MTRE, CME (single-phase and three-phase, up to 11 kW + three-phase, 11-22 kW)
 - Grundfos TPE, TPE Series 2000, NBE, NKE (single-phase and three-phase, up to 11 kW + three-phase, 11-22 kW)
 - Grundfos CUE frequency converter (all versions, 0.55 - 250 kW)
 - Grundfos Hydro MPC (CU 35X)* and Hydro Multi-E booster systems
 - Grundfos Control MPC (CU 35X)* multipump controller
 - Grundfos Hydro Multi-B (CU 323) booster system.
 - Grundfos Level Control LC 2X1 level control system for wastewater pumps
 - Grundfos Level Control LC 2X2 level control system for submersible pumps
- * Additional Grundfos GENIbus module required.

4. Complete object list

4.1 Complete object list for pumps

Table Legend

3	Only available on MAGNA3.
G	Only available on model G and later versions.
•	Always available.
S	Sensor required.
S*	On TPE Series 2000 and MAGNA/UPE, the flow is estimated and is only to be used for monitoring, not for control purposes. On all other pump types, a flow sensor is required.
CUE	Only available on CUE (with sensor).
3-ph	Only available on three-phase E-pumps.

ID	Object Name	R/W	Notes	MAGNA /UPE Series	E-pumps 0.25 - 7.5 kW	CUE/ E-pumps 11-22 kW
BI, 0	Control source status	R	Status of the actual control source. 0: Local control 1: Bus control.	•	•	•
BI, 1	Actual direction	R	Rotational direction of the pump impeller. 0: Clockwise 1: Counterclockwise.	3	•	•
BI, 2	Rotation status	R	Rotation status. 0: No rotation 1: Rotation (pump running).	•	•	•
BI, 3	At minimum speed	R	0: Not running at minimum speed 1: Running at minimum speed.	•	•	•
BI, 4	At maximum speed	R	0: Not running at maximum speed 1: Running at maximum speed.	•	•	•
BI, 11	Digital input 1 status	R	0: Not active 1: Active.	3	•	•
BI, 12	Digital input 2 status	R	0: Not active 1: Active.	3	•	•
BI, 13	Digital input 3 status	R	0: Not active 1: Active.	-	•	•
BI, 14	Digital output 1 status	R	0: Not active 1: Active.	3	•	•
BI, 15	Digital output 2 status	R	0: Not active 1: Active.	3	•	•
BI, 28	Fault simulation status	R	Fault simulation status. 0: Fault simulation not active 1: Fault simulation active.	•	•	•
BI, 31	At power limit	R	0: Not running at power limit 1: Running at power limit.	3	-	-
BI, 38	Setpoint influence	R	0: Not active 1: Active.	•	-	-

ID	Object Name	R/W	Notes	MAGNA /UPE Series	E-pumps 0.25 - 7.5 kW	CUE/ E-pumps 11-22 kW
BI, 39	Max. flow limit	R	0: Not active 1: Active.	3	-	-
BO, 0	Set control source	W	Sets the control source. Set to 1 to enable pump control via BACnet. 0: Local control (default) 1: Bus control.	•	•	•
BO, 1	Relay 1 control	W	Controls relay 1 if bus control is enabled and relay 1 is set to be controlled via bus. 0: Closed (default) 1: Open.	-	•	•
BO, 2	Relay 2 control	W	Controls relay 2 if bus control is enabled and relay 2 is set to be controlled via bus. 0: Closed (default) 1: Open.	-	-	•
BO, 4	Reset fault	W	Resets fault if bus control is enabled. (Triggered on rising edge). 0: No resetting (default) 1: Resetting.	•	•	•
BO, 5	Fault simulation	W	Enables simulated fault if bus control is enabled. 0: Disabled (default) 1: Enabled.	•	•	•
BO, 6	Copy settings to local	W	Copies remote settings to local pump settings. 0: Disabled 1: Enabled.	3	-	-
BO, 9	Enable max. flow limit	W	0: Disabled 1: Enabled.	3	-	-
MI, 0	Actual control mode	R	Reads the current control mode. 1: Constant speed 2: Constant pressure 3: Proportional pressure 4: Automatic / AUTO _{ADAPT} 5: Constant flow 6: Constant temperature 7: Constant level 8: Constant percentage 9: Auto flow 10: Closed-loop sensor control.	•	•	•
MI, 1	Actual operating mode	R	Reads the current operating mode. 1: Start (normal) 2: Stop 3: Minimum 4: Maximum.	•	•	•
MI, 2	Next bearing-service type	R	Type of next bearing service. 1: Service type unknown 2: Lubricate bearings 3: Change bearings.	-	-	•

ID	Object Name	R/W	Notes	MAGNA /UPE Series	E-pumps 0.25 - 7.5 kW	CUE/ E-pumps 11-22 kW
MI, 3	CIM status	R	Reads the status of the CIM module, useful for fault finding. 1: OK 2: EEPROM fault 3: Memory fault.	•	•	•
MI, 11	Feedback sensor unit	R	Unit of the feedback sensor. 1: Unknown 2: bar 3: mbar 4: m 5: kPa 6: psi 7: ft 8: m ³ /h 9: m ³ /s 10: l/s 11: gpm 12: °C 13: °F 14: % 15: K 16: l/h.	•	•	•
MO, 0	Set control mode	W	Sets the control mode if bus control is enabled. 1: Constant speed 2: Constant pressure 3: Proportional pressure 4: Automatic / AUTO _{ADAPT} 5: Constant flow 6: Constant temperature 7: Constant level 8: Constant percentage 9: Auto flow 10: Closed-loop sensor control.	•	•	•
MO, 1	Set operating mode	W	Sets the operating mode if bus control is enabled. 1: Start (normal) 2: Stop 3: Minimum 4: Maximum.	•	•	•
AI, 0	Fault code	R	Grundfos fault code.	•	•	•
AI, 1	Warning code	R	Grundfos warning code.	3	•	•
AI, 2	Time to bearing service	R	Time to bearing service in months. A value of 24 means "24 or more".	-	-	•
AI, 3	Capacity	R	Actual capacity value (process feedback).	•	•	•
AI, 4	Head	R	Actual system head/pressure.	S	S	S
AI, 5	Flow	R	Actual system flow.	S*	S*	S*
AI, 6	Relative performance	R	Performance relative to maximum performance.	•	•	•
AI, 7	Speed	R	Motor speed.	•	•	•
AI, 8	Frequency	R	Actual control signal applied to motor.	•	•	•

ID	Object Name	R/W	Notes	MAGNA /UPE Series	E-pumps 0.25 - 7.5 kW	CUE/ E-pumps 11-22 kW
Al, 9	Actual setpoint	R	Actual setpoint.	•	•	•
Al, 10	Motor current	R	Actual motor current.	3	•	•
Al, 11	DC link voltage	R	Frequency converter DC Link voltage.	•	•	•
Al, 12	Motor voltage	R	Motor voltage.	-	•	•
Al, 13	Power	R	Total power consumption of the pump.	•	•	•
Al, 14	Remote flow	R	Measured flow at external sensor.	3+S	G+S	S
Al, 15	Inlet pressure	R	System inlet pressure.	-	G+S	S
Al, 16	Remote pressure	R	Measured pressure at external sensor.	3+S	G+S	S
Al, 17	Level	R	Tank level.	-	S	S
Al, 18	Power electronic temperature	R	Temperature in frequency converter.	3	•	•
Al, 19	Motor temperature	R	Motor winding temperature.	-	G	•
Al, 20	Remote temperature	R	Temperature at external sensor.	-	S	S
Al, 21	Electronic temperature	R	Pump electronics temperature.	-	-	S
Al, 22	Fluid temperature	R	Pumped-liquid temperature.	•	G	S
Al, 23	Bearing temperature DE	R	Bearing temperature, drive end.	-	-	S
Al, 24	Bearing temperature NDE	R	Bearing temperature, non-drive end.	-	-	S
Al, 25	Auxiliary sensor input	R	Auxiliary sensor input.	-	S	S
Al, 26	Specific energy	R	Specific energy consumption.	3	-	CUE
Al, 27	Runtime	R	Total operating time of the pump.	•	•	•
Al, 28	Total ontime	R	Total power-on time of the pump.	•	•	•
Al, 29	Torque	R	Motor torque.	-	3-ph	•
Al, 30	Energy consumption	R	Total energy consumption of the pump.	•	•	•
Al, 31	Number of starts	R	Number of times the pump has started.	3	•	•
Al, 32	Volume	R	Total pumped volume.	3	-	CUE
Al, 37	Outlet pressure	R	System outlet pressure.	-	H	-
Al, 57	Remote temperature 2	R	Temperature at external temperature sensor 2.	3+S	-	-
Al, 58	User setpoint	R	User-selected setpoint.	•	•	•
Al, 85	Minimum of feedback sensor	R	Minimum value of feedback sensor.	•	•	•
Al, 86	Maximum of feedback sensor	R	Maximum value of feedback sensor.	•	•	•
Al, 92	Load percent	R	Motor current in percent of rated motor current.	3	-	-

ID	Object Name	R/W	Notes	MAGNA /UPE Series	E-pumps 0.25 - 7.5 kW	CUE/ E-pumps 11-22 kW
AI, 93	Differential pressure	R	Pressure between pump flanges.	3	-	-
AI, 95	Actual flow limit	R	Actual maximum flow limit.	3	-	-
AO, 0	Set setpoint	W	Sets the pump setpoint if bus control is enabled. A value of 0 does not imply a stop.	•	•	•
AO, 5	Set max. flow limit	W	Sets the maximum flow limit value.	3	-	-
AV, 0	Custom device object instance number	R/W	Value for Custom Device Object Instance Number. Used in conjunction with DIP switch SW3. Present_Value range: 0-0x3FFFFE. Default Present_Value: 0xE7.	•	•	•
AV, 2	Simulation fault code	R/W	Fault code to simulate. Can be cleared by writing a value of 0.	•	•	•
AV, 3	Simulation warning code	R/W	Warning code to simulate. Can be cleared by writing a value of 0.	3	•	•
AV, 9	Product time and date	R/W	Pump time and date in UNIX format (seconds since 00:00 01-01-1970).	3	-	-
AV, 12	Remote sensor feedback	R/W	Sensor value communicated via fieldbus.	-	H	-

4.2 Complete object list for booster systems

Table Legend

- 3
- Only available on MAGNA3.
- G
- Only available on model G and later versions.
-
- Always available.
- S
- Sensor required.
- S*
- On TPE Series 2000 and MAGNA/UPE, the flow is estimated and is only to be used for monitoring, not for control purposes. On all other pump types, a flow sensor is required.
- CUE
- Only available on CUE (with sensor).
- 3-ph
- Only available on three-phase E-pumps.

ID	Object Name	R/W	Notes	Units	Hydro Multi-B	Hydro MPC	Hydro Multi-E
Bl, 0	Control source status	R	Status of the actual control source. 0: Local control 1: Bus control.	-	•	•	•
Bl, 2	Rotation status	R	Rotation status. 0: No rotation 1: Rotation (one or more pumps running).	-	•	•	•
Bl, 3	At minimum speed	R	0: Not running at minimum speed 1: Running at minimum speed.	-	-	•	•
Bl, 4	At maximum speed	R	0: Not running at maximum speed 1: Running at maximum speed.	-	-	•	•
Bl, 5	Standby pumps active	R	0: Standby pumps not active 1: Standby pumps active.	-	-	•	-
Bl, 6	Pressure relief active	R	0: Pressure relief not active 1: Pressure relief active.	-	-	•	-
Bl, 7	Soft pressure active	R	0: Soft pressure not active 1: Soft pressure active.	-	-	•	-
Bl, 8	Low-flow boost active	R	0: Low-flow boost not active 1: Low-flow boost active.	-	-	•	-
Bl, 9	Low-flow stop active	R	0: Low-flow stop not active 1: Low-flow stop active.	-	•	•	-
Bl, 10	Alternative setpoint active	R	0: Alternative setpoint not active 1: Alternative setpoint active.	-	-	•	-
Bl, 11	Digital input 1 status	R	0: Not active 1: Active.	-	•	•	•
Bl, 12	Digital input 2 status	R	0: Not active 1: Active.	-	•	•	•
Bl, 13	Digital input 3 status	R	0: Not active 1: Active.	-	•	•	•
Bl, 14	Digital output 1 status	R	0: Not active 1: Active.	-	•	•	•
Bl, 15	Digital output 2 status	R	0: Not active 1: Active.	-	•	•	•
Bl, 16	Subpump 1 presence	R	0: Subpump not present 1: Subpump present.	-	•	•	•

ID	Object Name	R/W	Notes	Units	Hydro Multi-B	Hydro MPC	Hydro Multi-E
BI, 17	Subpump 1 communication status	R	0: Communication OK 1: Communication fault.	-	•	•	•
BI, 18	Subpump 2 presence	R	0: Subpump not present 1: Subpump present.	-	•	•	•
BI, 19	Subpump 2 communication status	R	0: Communication OK 1: Communication fault.	-	•	•	•
BI, 20	Subpump 3 presence	R	0: Subpump not present 1: Subpump present.	-	•	•	•
BI, 21	Subpump 3 communication status	R	0: Communication OK 1: Communication fault.	-	•	•	•
BI, 22	Subpump 4 presence	R	0: Subpump not present 1: Subpump present.	-	•	•	•
BI, 23	Subpump 4 communication status	R	0: Communication OK 1: Communication fault.	-	•	•	•
BI, 24	Subpump 5 presence	R	0: Subpump not present 1: Subpump present.	-	-	•	•
BI, 25	Subpump 5 communication status	R	0: Communication OK 1: Communication fault.	-	-	•	•
BI, 26	Subpump 6 presence	R	0: Subpump not present 1: Subpump present.	-	-	•	•
BI, 27	Subpump 6 communication status	R	0: Communication OK 1: Communication fault.	-	-	•	•
BI, 28	Fault simulation status	R	Fault simulation status. 0: Fault simulation disabled 1: Fault simulation enabled.	-	•	•	-
BI, 32	Subpump 1 auto mode	R	0: Manual control 1: Auto-control.	-	•	•	-
BI, 33	Subpump 2 auto mode	R	0: Manual control 1: Auto-control.	-	•	•	-
BI, 34	Subpump 3 auto mode	R	0: Manual control 1: Auto-control.	-	•	•	-
BI, 35	Subpump 4 auto mode	R	0: Manual control 1: Auto-control.	-	•	•	-
BI, 36	Subpump 5 auto mode	R	0: Manual control 1: Auto-control.	-	-	•	-
BI, 37	Subpump 6 auto mode	R	0: Manual control 1: Auto-control.	-	-	•	-
BI, 38	Setpoint influence active	R	0: No influence on setpoint 1: Setpoint influence active.	-	-	•	-
BI, 40	Pilot pump auto mode	R	0: Manual control 1: Auto-control.	-	-	•	-
BI, 41	Pilot pump presence	R	0: Pilot pump not present 1: Pilot pump present.	-	-	•	-
BI, 42	Pilot pump communication status	R	0: Communication OK 1: Communication fault.	-	-	•	-
BI, 43	Backup pump auto mode	R	0: Manual control 1: Auto-control.	-	-	•	-
BI, 44	Backup pump presence	R	0: Backup pump not present 1: Backup pump present.	-	-	•	-
BI, 45	Backup pump communication status	R	0: Communication OK 1: Communication fault.	-	-	•	-

ID	Object Name	R/W	Notes	Units	Hydro Multi-B	Hydro MPC	Hydro Multi-E
BO, 0	Set control source	W	Sets the control source. Set to 1 to enable control via BACnet. 0: Local control (default) 1: Bus control.	-	●	●	●
BO, 4	Reset fault	W	Resets alarm if bus control is enabled. (Triggered on rising edge). 0: No resetting (default) 1: Resetting.	-	●	●	●
BO, 5	Fault simulation	W	Enables fault simulation. 0: Disabled (default) 1: Enabled.	-	●	●	-
MI, 0	Actual control mode	R	Reads the current control mode. 1: Constant speed 2: Constant pressure 3: Proportional pressure 4: RESERVED 5: Constant flow 6: Constant temperature 7: Constant level 8: Constant percentage.	-	●	●	●
MI, 1	Actual operating mode	R	Reads the current operating mode. 1: Start (normal) 2: Stop 3: Minimum 4: Maximum.	-	●	●	●
MI, 3	CIM status	R	Reads the status of the CIM module, useful for fault finding. 1: OK 2: EEPROM fault 3: Memory fault.	-	●	●	●
MI, 4	Subpump 1 control source	R	1: Buttons 2: GENIbus 3: GENIlink 4: External control.	-	●	●	-
MI, 5	Subpump 2 control source	R	1: Buttons 2: GENIbus 3: GENIlink 4: External control.	-	●	●	-
MI, 6	Subpump 3 control source	R	1: Buttons 2: GENIbus 3: GENIlink 4: External control.	-	●	●	-
MI, 7	Subpump 4 control source	R	1: Buttons 2: GENIbus 3: GENIlink 4: External control.	-	●	●	-
MI, 8	Subpump 5 control source	R	1: Buttons 2: GENIbus 3: GENIlink 4: External control.	-	-	●	-
MI, 9	Subpump 6 control source	R	1: Buttons 2: GENIbus 3: GENIlink 4: External control.	-	-	●	-

ID	Object Name	R/W	Notes	Units	Hydro Multi-B	Hydro MPC	Hydro Multi-E
MI, 10	Application type	R	1: Pressure boosting 2: Heating pumps on hot side 3: Heating pumps on cold side 4: AirCon pumps on hot side 5: AirCon pumps on cold side 6: MPC S2000 heating pumps on hot side 7: MPC S2000 heating pumps on cold side 8: MPC S2000 AirCon pumps on hot side 9: MPC S2000 AirCon pumps on cold side 10: Tank filling 11: Tank filling (float switches) 12: Undefined.	-	•	•	-
MI, 11	Feedback sensor unit	R	1: Unknown 2: bar 3: mbar 4: m 5: kPa 6: psi 7: ft 8: m ³ /h 9: m ³ /s 10: l/s 11: gpm 12: °C 13: °F 14: % 15: K 16: l/h.	-	•	•	-
MI, 12	Pilot pump control source		1: Buttons 2: GENIbus 3: GENIlink 4: External control.	-	-	•	-
MI, 13	Backup pump control source		1: Buttons 2: GENIbus 3: GENIlink 4: External control.	-	-	•	-
MO, 0	Set control mode	W	Sets the control mode if bus control is enabled. 1: Constant speed 2: Constant pressure 3: Proportional pressure 4: RESERVED 5: Constant flow 6: Constant temperature 7: Constant level 8: Constant percentage. Note that Hydro Multi-E always runs in constant-pressure mode.	-	-	•	-
MO, 1	Set operating mode	W	Sets the operating mode if bus control is enabled. 1: Start (normal) 2: Stop 3: Minimum (Hydro MPC only) 4: Maximum (Hydro MPC and Hydro Multi-E only).	-	•	•	•

ID	Object Name	R/W	Notes	Units	Hydro Multi-B	Hydro MPC	Hydro Multi-E
MO, 2	Product simulation	W	Enables product simulation (for commissioning and testing purposes, can only be enabled when no physical booster system is present). 1: Disabled 5: Hydro Multi-E 6: Hydro MPC 7: Hydro Multi-B.	-	●	●	●
MO, 3	Control subpump 1	W	Manual control of subpump 1. 1: Automatic control (default) 2: Forced start (not available) 3: Forced stop.	-	●	●	-
MO, 4	Control subpump 2	W	Manual control of subpump 2. 1: Automatic control (default) 2: Forced start (not available) 3: Forced stop.	-	●	●	-
MO, 5	Control subpump 3	W	Manual control of subpump 3. 1: Automatic control (default) 2: Forced start (not available) 3: Forced stop.	-	●	●	-
MO, 6	Control subpump 4	W	Manual control of subpump 4. 1: Automatic control (default) 2: Forced start (not available) 3: Forced stop.	-	●	●	-
MO, 7	Control subpump 5	W	Manual control of subpump 5. 1: Automatic control (default) 2: Forced start (not available) 3: Forced stop.	-	-	●	-
MO, 8	Control subpump 6	W	Manual control of subpump 6. 1: Automatic control (default) 2: Forced start (not available) 3: Forced stop.	-	-	●	-
MO, 9	Control pilot pump	W	Manual control of pilot pump. 1: Automatic control (default) 2: Forced start (not available) 3: Forced stop.	-	-	●	-
MO, 10	Control back-up pump	W	Manual control of back-up pump. 1: Automatic control (default) 2: Forced start (not available) 3: Forced stop.	-	-	●	-
AI, 0	Fault code	R	Grundfos fault code.	-	●	●	●
AI, 1	Warning code	R	Grundfos warning code.	-	●	●	●
AI, 3	Capacity	R	Actual capacity value (process feedback).	%	●	●	●
AI, 4	Head	R	Actual system head/pressure.	bar	-	S	S
AI, 5	Flow	R	Actual system flow.	m ³ /h	-	S	S
AI, 6	Relative performance	R	Performance relative to maximum performance.	%	●	●	●
AI, 9	Actual setpoint	R	Actual setpoint.	%	●	●	●
AI, 10	Motor current	R	Actual motor current.	A	-	-	●
AI, 13	Power	R	Total power consumption of the system.	W	●	●	●
AI, 15	Inlet pressure	R	System inlet pressure.	bar	S	S	-

ID	Object Name	R/W	Notes	Units	Hydro Multi-B	Hydro MPC	Hydro Multi-E
AI, 16	Remote pressure	R	Measured pressure at external sensor.	bar	-	S	-
AI, 17	Level	R	Tank level.	m	S	S	S
AI, 20	Remote temperature	R	Temperature at external sensor.	°C	-	S	S
AI, 25	Auxiliary sensor input	R	Auxiliary sensor input.	%	S	-	S
AI, 26	Specific Energy	R	Specific energy of the system.	kWh/ m3	-	S	-
AI, 27	Runtime	R	Total operating time of the system.	h	●	●	●
AI, 30	Energy consumption	R	Total energy consumption of the system.	kWh	●	●	●
AI, 33	Ambient temperature	R	Ambient temperature.	°C	-	S	-
AI, 34	Forward temperature	R	Flow-pipe temperature.	°C	-	S	-
AI, 35	Return temperature	R	Return-pipe temperature.	°C	-	S	-
AI, 36	Differential temperature	R	Differential temperature.	°C	-	S	-
AI, 37	Outlet pressure	R	System outlet pressure.	bar	S	S	-
AI, 38	Feed tank level	R	Actual level in the feed tank.	m	-	S	-
AI, 39	Subpump1 fault code	R	Fault code, subpump 1.	-	●	●	●
AI, 40	Subpump 1 runtime	R	Total operating time, subpump 1.	h	●	●	●
AI, 41	Subpump 1 speed	R	Actual speed, subpump 1.	%	●	●	-
AI, 42	Subpump 2 fault code	R	Fault code, subpump 2.	-	●	●	●
AI, 43	Subpump 2 runtime	R	Total operating time, subpump 2.	h	●	●	●
AI, 44	Subpump 2 speed	R	Actual speed, subpump 2.	%	●	●	-
AI, 45	Subpump 3 fault code	R	Fault code, subpump 3.	-	●	●	●
AI, 46	Subpump 3 runtime	R	Total operating time, subpump 3.	h	●	●	●
AI, 47	Subpump 3 speed	R	Actual speed, subpump 3.	%	●	●	-
AI, 48	Subpump 4 fault code	R	Fault code, subpump 4.	-	●	●	●
AI, 49	Subpump 4 runtime	R	Total operating time, subpump 4.	h	●	●	●
AI, 50	Subpump 4 speed	R	Actual speed, subpump 4.	%	●	●	-
AI, 51	Subpump 5 fault code	R	Fault code, subpump 5.	-	-	●	●
AI, 52	Subpump 5 runtime	R	Total operating time, subpump 5.	h	-	●	●
AI, 53	Subpump 5 speed	R	Actual speed, subpump 5.	%	-	●	-
AI, 54	Subpump 6 fault code	R	Fault code, subpump 6.	-	-	●	●
AI, 55	Subpump 6 runtime	R	Total operating time, subpump 6.	h	-	●	●
AI, 56	Subpump 6 speed	R	Actual speed, subpump 6.	%	-	●	-
AI, 58	User setpoint	R	User-defined setpoint.	%	●	●	-
AI, 59	Analogue influence	R	Analog setpoint influence.	%	●	●	-
AI, 60	Power-on counter	R	Number of power-on cycles.	-	●	●	-
AI, 61	Subpump 1	R	Line current, subpump 1.	A	●	●	-
AI, 62	Subpump 1	R	Power consumption, subpump 1.	W	●	●	-
AI, 63	Subpump 1	R	Motor temperature, subpump 1.	°C	●	●	-
AI, 64	Subpump 1	R	Number of starts, subpump 1.	-	●	●	-
AI, 65	Subpump 2	R	Line current, subpump 2.	A	●	●	-

ID	Object Name	R/W	Notes	Units	Hydro Multi-B	Hydro MPC	Hydro Multi-E
AI, 66	Subpump 2	R	Power consumption, subpump 2.	W	●	●	-
AI, 67	Subpump 2	R	Motor temperature, subpump 2.	°C	●	●	-
AI, 68	Subpump 2	R	Number of starts, subpump 2.	-	●	●	-
AI, 69	Subpump 3	R	Line current, subpump 3.	A	●	●	-
AI, 70	Subpump 3	R	Power consumption, subpump 3.	W	●	●	-
AI, 71	Subpump 3	R	Motor temperature, subpump 3.	°C	●	●	-
AI, 72	Subpump 3	R	Number of starts, subpump 3.	-	●	●	-
AI, 73	Subpump 4	R	Line current, subpump 4.	A	●	●	-
AI, 74	Subpump 4	R	Power consumption, subpump 4.	W	●	●	-
AI, 75	Subpump 4	R	Motor temperature, subpump 4.	°C	●	●	-
AI, 76	Subpump 4	R	Number of starts, subpump 4.	-	●	●	-
AI, 77	Subpump 5	R	Line current, subpump 5.	A	-	●	-
AI, 78	Subpump 5	R	Power consumption, subpump 5.	W	-	●	-
AI, 79	Subpump 5	R	Motor temperature, subpump 5.	°C	-	●	-
AI, 80	Subpump 5	R	Number of starts, subpump 5.	-	-	●	-
AI, 81	Subpump 6	R	Line current, subpump 6.	A	-	●	-
AI, 82	Subpump 6	R	Power consumption, subpump 6.	W	-	●	-
AI, 83	Subpump 6	R	Motor temperature, subpump 6.	°C	-	●	-
AI, 84	Subpump 6	R	Number of starts, subpump 6.	-	-	●	-
AI, 85	Minimum of feedback sensor	R	Minimum of feedback sensor.	(see MI, 11 for unit)	-	●	●
AI, 86	Maximum of feedback sensor	R	Maximum of feedback sensor.	(see MI, 11 for unit)	-	●	●
AI, 87	Actual tank-filling tank height	R	Tank height in tank-filling mode.	m	●	-	-
AI, 88	Actual tank-filling start limit	R	Start limit in percent of tank height.	%	●	-	-
AI, 89	Actual tank-filling stop limit	R	Stop limit in percent of tank height.	%	●	-	-
AI, 90	Actual tank-filling alarm high-limit	R	Alarm high-limit in percent of tank height.	%	●	-	-
AI, 91	Actual tank-filling warning low-limit	R	Warning low-limit in percent of tank height.	%	●	-	-
AI, 96	Specific energy average	R	Average specific energy.	kWh/m ³	-	S	-
AI, 97	Flow measurement 1	R	Flow measurement 1.	m ³ /h	-	S	-
AI, 98	Flow measurement 2	R	Flow measurement 2.	m ³ /h	-	S	-
AI, 99	Flow measurement 3	R	Flow measurement 3.	m ³ /h	-	S	-
AI, 100	Pilot pump fault code	R	Fault code, pilot pump.	-	-	●	-
AI, 101	Pilot pump runtime	R	Total operating time, pilot pump.	h	-	●	-
AI, 102	Pilot pump speed	R	Actual speed, pilot pump.	%	-	●	-
AI, 103	Pilot pump line current	R	Line current, pilot pump.	A	-	●	-

ID	Object Name	R/W	Notes	Units	Hydro Multi-B	Hydro MPC	Hydro Multi-E
AI, 104	Pilot pump power consumption	R	Power consumption, pilot pump.	W	-	●	-
AI, 105	Pilot pump motor temperature	R	Motor temperature, pilot pump.	°C	-	●	-
AI, 106	Pilot pump number of starts	R	Number of starts, pilot pump.	-	-	●	-
AI, 107	Backup pump fault code	R	Fault code, backup pump.	-	-	●	-
AI, 108	Backup pump runtime	R	Total operating time, backup pump.	h	-	●	-
AI, 109	Backup pump speed	R	Actual speed, backup pump.	%	-	●	-
AI, 110	Backup pump line current	R	Line current, backup pump.	A	-	●	-
AI, 111	Backup pump power consumption	R	Power consumption, backup pump.	W	-	●	-
AI, 112	Backup pump motor temperature	R	Motor temperature, backup pump.	°C	-	●	-
AI, 113	Backup pump number of starts	R	Number of starts, backup pump.	-	-	●	-
AI, 122	Subpump 1	R	Energy consumption	kWh	-	●	-
AI, 123	Subpump 2	R	Energy consumption	kWh	-	●	-
AI, 124	Subpump 3	R	Energy consumption	kWh	-	●	-
AI, 125	Subpump 4	R	Energy consumption	kWh	-	●	-
AI, 126	Subpump 5	R	Energy consumption	kWh	-	●	-
AI, 127	Subpump 6	R	Energy consumption	kWh	-	●	-
AI, 128	Pilot pump	R	Energy consumption	kWh	-	●	-
AI, 129	Backup pump	R	Energy consumption	kWh	-	●	-
AO, 0	Set setpoint	W	Sets the booster system setpoint if bus control is enabled. A value of 0 does not imply a stop.	%	●	●	●
AO, 1	Tank-filling start limit	W	Sets the start limit in percent of tank height.	%	●	-	-
AO, 2	Tank-filling stop limit	W	Sets the stop limit in percent of tank height.	%	●	-	-
AO, 3	Tank-filling alarm high-limit	W	Sets the alarm high-limit in percent of tank height.	%	●	-	-
AO, 4	Tank-filling warning low-limit	W	Sets the warning low-limit in percent of tank height.	%	●	-	-
AV, 0	Custom device object instance number	R/W	Value for Custom Device Object Instance Number. Used in conjunction with DIP switch SW3. Present_Value range: 0-0x3FFFFE. Default Present_Value: 0xE7.	-	●	●	●

ID	Object Name	R/W	Notes	Units	Hydro Multi-B	Hydro MPC	Hydro Multi-E
AV, 4	Simulation event code	R/W	Event code to simulate. The following event code values are available for simulation of CU 35X (among others): 000: No alarm 003: External fault 010: Booster system communication alarm 089: Closed-loop feedback sensor signal fault 088: General (measuring) sensor signal fault 203: All pumps in alarm 210: Pressure high 211: Pressure low 214: Water shortage 231: No Ethernet address from DHCP server.	-	•	•	-
AV, 5	Simulation device type	R/W	Device type of simulated event. 0: Controller 2: Pump 3: IO 351 4: Primary sensor 7: IO 351 8: System 9: Analog input 10: Pilot booster system 11: Limit-exceeded function.	-	•	•	-
AV, 6	Simulation device number	R/W	Device number of simulated event. If the device type is "Pump", the device number indicates the pump number [1-6]. If the device type is "Analog input", the device number indicates the sensor that generated the event [1-7].	-	•	•	-
AV, 7	Simulation event action type	R/W	The associated action to the event. 0: Go to operating mode "Stop". 1: Go to operating mode "Stop" (delay). 2: Go to operating mode "Minimum". 3: Go to operating mode "User-defined". 4: Go to operating mode "Maximum". 5: Set pumps in source mode to "Local control". 6: No action (warning only). 7: Go to operating mode "Emergency run".	-	-	•	-
AV, 8	Simulation event reset type	R/W	Resetting type for simulated event. Manual or automatic. 0: Manual resetting 1: Automatic resetting.	-	-	•	-
AV, 10	Proportional-control reduction	R/W	Reduction in % to be used in proportional-pressure control mode.	%	-	•	-

ID	Object Name	R/W	Notes	Units	Hydro Multi-B	Hydro MPC	Hydro Multi-E
AV. 11	Proportional-control flow max.	R/W	Max. flow in m ³ /h to be used in proportional-pressure control mode.	m ³ /h	-	●	-
AV. 13	Remote Sensor 1	R/W	Remote Sensor 1 via BACnet (CU 352)	%	-	●	-
AV. 14	Remote Sensor 2	R/W	Remote Sensor 2 via BACnet (CU 352)	%	-	●	-
AV. 15	Remote Sensor 3	R/W	Remote Sensor 3 via BACnet (CU 352)	%	-	●	-
AV. 16	Remote Sensor 4	R/W	Remote Sensor 4 via BACnet (CU 352)	%	-	●	-
AV. 17	Remote Sensor 5	R/W	Remote Sensor 5 via BACnet (CU 352)	%	-	●	-
AV. 18	Remote Sensor 6	R/W	Remote Sensor 6 via BACnet (CU 352)	%	-	●	-

4.3 Complete object list for Level Control LC 2X1

ID	Object Name	R/W	Notes	Units
AV, 0	Custom device object instance number	R/W	Present_Value range: 0-0x3FFFFE. Default Present_Value: 0xE7. [RD: 0]	-
AV, 1	Product time and date	R/W	Set clock in UNIX format.	s
BO, 0	Reset alarms	W	0: No resetting 1: Resetting alarms	-
MO, 0	Control Pump 1	W	1: Auto 2: Forced Start 3: Forced Stop	-
MO, 1	Control Pump 2	W	1: Auto 2: Forced Start 3: Forced Stop	-
AO, 0	SetHighLevel	W	Set high level in centimetres.	cm
AO, 1	SetDryRunningLevel	W	Set dry running level in centimetres.	cm
AO, 2	SetStartLevelPump1	W	Set start level for pump 1 in centimetres.	cm
AO, 3	SetStopLevelPump1	W	Set stop level for pump 1 in centimetres.	cm
AO, 4	SetStartLevelPump2	W	Set start level for pump 2 in centimetres.	cm
MI, 0	System Operating Mode	R	0: Standby 1: Start-up delay 2: Pumping 3: Stop delay 4: Pumping max 5: Stopped 6: Foam draining 7: Daily emptying 8: Pump anti-seizing 9: Manual control 10: Interlock control 11: Mains failure 12: Level sensor error 13: All pumps in alarm 14: All pumps out of operation 15: Service mode, alarms suppressed	-
MI, 1	CIM status	R	1: OK 2: EEPROM fault 3: Memory fault 4: Unknown	-
MI, 3	System control sensor type	R	Reports the type of sensor controlling the system. Possible values: • 1: Analog level sensor • 2: Float switch • 3: Unknown	-
AI, 0	Fault code	R	Grundfos fault code	-
AI, 1	Warning code	R	Grundfos warning code	-
AI, 2	HighLevel	R	High level in centimetres.	cm
AI, 3	StartLevelPump1	R	Start level for pump 1 in centimetres.	cm
AI, 4	StopLevelPump1	R	Stop level for pump 1 in centimetres.	cm
AI, 5	StartLevelPump2	R	Start level for pump 2 in centimetres.	cm
AI, 6	Pit water level	R	Pit water level in centimetres.	cm

ID	Object Name	R/W	Notes	Units
AI, 7	Pit power consumption	R	Pit power consumption in watts.	W
AI, 8	Pit energy consumption	R	Pit energy consumption in kilowatt hours.	kWh
AI, 9	Pit running time	R	Pit running time in minutes.	min
AI, 10	Analog Input 1 (AI1)	R	Analog Input 1	%
AI, 11	Analog Input 2 (AI2)	R	Analog Input 2	%
AI, 12	Analog input 3 (AI3)	R	Analog Input 3	%
AI, 13	Pump1 time to service	R	Pump 1 time to service in minutes.	min
AI, 14	Pump2 time to service	R	Pump 2 time to service in minutes.	min
AI, 15	Pump1 start counter	R	Pump 1 start counter.	-
AI, 16	Pump2 start counter	R	Pump 2 start counter.	-
AI, 17	Pump1 current	R	Pump 1 current in amperes.	A
AI, 18	Pump2 current	R	Pump 2 current in amperes.	A
AI, 19	Pump1 operating time	R	Pump 1 overall operating time in minutes.	min
AI, 20	Pump2 operating time	R	Pump 2 overall operating time in minutes.	min
AI, 21	UserAnalogInput1	R	User-defined measurement, analog input 1.	%
AI, 22	UserAnalogInput2	R	User-defined measurement, analog input 2.	%
AI, 23	UserAnalogInput3	R	User-defined measurement, analog input 3.	%
AI, 24	UserAnalogInput4	R	User-defined measurement, analog input 4.	%
AI, 25	UserAnalogInput5	R	User-defined measurement, analog input 5.	%
AI, 26	Latest operating time pump1	R	Pump 1 latest running time in minutes.	min
AI, 27	Latest operating time pump2	R	Pump 2 latest running time in minutes.	min
AI, 28	Energy consumption pump1	R	Pump 1 energy consumption in kilowatt hours.	kWh
AI, 29	Energy consumption pump2	R	Pump 2 energy consumption in kilowatt hours.	kWh
AI, 39	Alarms 1-5 and warnings 1-5	R	Values are transmitted in the following order: <ul style="list-style-type: none"> • bit 0: Status warnings1 • bit 1: Status warnings2 • bit 2: Status warnings3 • bit 3: Status warnings4 • bit 4: Status warnings5 • bit 8: Status alarms1 • bit 9: Status alarms2 • bit 10: Status alarms3 • bit 11: Status alarms4 • bit 12: Status alarms5 	-
			Bit values indicate the following: <ul style="list-style-type: none"> • bit value 0: Alarm or warning not present • bit value 1: Alarm or warning present 	

ID	Object Name	R/W	Notes	Units
AI, 40	Sensor present status	R	Values are transmitted in the following order: <ul style="list-style-type: none"> • bit 0: Flow sensor present • bit 1: Power/energy sensor present • bit 2: AI sensor 1 present • bit 3: AI sensor 2 present • bit 4: AI sensor 3 present • bit 5: AI sensor 4 present • bit 6: AI sensor 5 present • bit 7: Turbidity sensor present • bit 8: pH sensor present • bit 9: Conductivity sensor present • bit 10: Pulse flow meter present • bit 11: Pressure sensor present • bit 12: Level sensor present 	-
			Bit values indicate the following: <ul style="list-style-type: none"> • bit value 0: Sensor not present • bit value 1: Sensor present 	
BI, 0	AcknowledgeAlarm	R	0: Not acknowledged 1: Acknowledged	-
BI, 1	FloatSwitch1Status	R	0: Off (Float switch down) 1: On (Float switch up)	-
BI, 2	FloatSwitch2Status	R	0: Off (Float switch down) 1: On (Float switch up)	-
BI, 3	FloatSwitch3Status	R	0: Off (Float switch down) 1: On (Float switch up)	-
BI, 4	FloatSwitch4Status	R	0: Off (Float switch down) 1: On (Float switch up)	-
BI, 5	FloatSwitch5Status	R	0: Off (Float switch down) 1: On (Float switch up)	-
BI, 6	Pump1Present	R	0: Not present 1: Present	-
BI, 7	Pump2Present	R	0: Not present 1: Present	-
BI, 8	Pump1Running	R	0: Not running 1: Running	-
BI, 9	Pump2Running	R	0: Not running 1: Running	-
BI, 10	Pump1CommFault	R	0: No communication fault 1: Pump or auxiliary device communication fault	-
BI, 11	Pump2CommFault	R	0: No communication fault 1: Pump or auxiliary device communication fault	-
BI, 12	Pump1Alarm	R	0: No Alarm 1: Alarm	-
BI, 13	Pump2Alarm	R	0: No Alarm 1: Alarm	-
BI, 14	Pump1Warning	R	0: No warning 1: Warning	-
BI, 15	Pump2Warning	R	0: No warning 1: Warning	-

ID	Object Name	R/W	Notes	Units
BI, 16	Pump1Disabled	R	0: Enabled 1: Disabled (Out of operation)	-
BI, 17	Pump2Disabled	R	0: Enabled 1: Disabled (Out of operation)	-
BI, 18	UserDigitalInBlock1, DI 1	R	0: Inactive 1: Active	-
BI, 19	UserDigitalInBlock1, DI 2	R	0: Inactive 1: Active	-
BI, 20	UserDigitalInBlock1, DI 3	R	0: Inactive 1: Active	-
BI, 21	UserDigitalInBlock1, DI 4	R	0: Inactive 1: Active	-
BI, 22	UserDigitalInBlock1, DI 5	R	0: Inactive 1: Active	-
BI, 23	UserDigitalInBlock1, DI 6	R	0: Inactive 1: Active	-
BI, 24	UserDigitalInBlock1, DI 7	R	0: Inactive 1: Active	-
BI, 25	UserDigitalInBlock1, DI 8	R	0: Inactive 1: Active	-
BI, 26	UserDigitalInBlock1, DI 9	R	0: Inactive 1: Active	-
BI, 27	UserDigitalInBlock1, DI 10	R	0: Inactive 1: Active	-
BI, 28	UserDigitalInBlock1, DI 11	R	0: Inactive 1: Active	-
BI, 29	UserDigitalInBlock1, DI 12	R	0: Inactive 1: Active	-
BI, 30	UserDigitalInBlock1, DI 13	R	0: Inactive 1: Active	-
BI, 31	UserDigitalInBlock1, DI 14	R	0: Inactive 1: Active	-
BI, 32	UserDigitalInBlock1, DI 15	R	0: Inactive 1: Active	-
BI, 33	UserDigitalInBlock1, DI 16	R	0: Inactive 1: Active	-

4.4 Complete object list for Level Control LC 2X2

ID	Object Name	R/W	Notes	Units
AV, 0	Custom device object instance number	R/W	Present_Value range: 0-0x3FFFFE. Default Present_Value: 0xE7. [RD = 0]	-
AV, 1	Product time and date	R/W	Set clock in UNIX format	s
AV, 2	CIMSoftwareVersion	R	Decimal value	-
BO, 0	Reset alarms	W	0: No resetting 1: Resetting alarms	-
BO, 1	Reset EventLog	W	0: No resetting 1: Resetting alarms	-
MO, 0	Control Pump 1	W	1: Auto 2: Forced Start 3: Forced Stop	-
MO, 1	Control Pump 2	W	1: Auto 2: Forced Start 3: Forced Stop	-
AO, 0	SetHighLevel	W	Set high level in centimetres.	cm
AO, 1	SetDryRunningLevel	W	Set dry running level in centimetres.	cm
AO, 2	SetStartLevelPump1	W	Set start level for pump 1 in centimetres.	cm
AO, 3	SetStopLevelPump1	W	Set stop level for pump 1 in centimetres.	cm
AO, 4	SetStartLevelPump2	W	Set start level for pump 2 in centimetres.	cm
MI, 0	System Operating Mode	R	0: Standby 1: Start-up delay 2: Pumping 3: Stop delay 4: Pumping max 5: Stopped 6: Foam draining 7: Daily emptying 8: Pump anti-seizing 9: Manual control 10: Interlock control 11: Mains failure 12: Level sensor error 13: All pumps in alarm 14 = All pumps out of operation 15: Service mode, alarms suppressed	-
MI, 1	CIM status	R	1: OK 2: EEPROM fault 3: Memory fault 4: Unknown	-
MI, 2	System status	R	STATUS_MAIN_STATUS reported by bits 0-2. Possible values: • 1: System OK • 2: Warnings present • 3: Alarms Present • 4: Unknown	-
MI, 3	System control sensor type	R	Reports the type of sensor controlling the system. Possible values: • 1: Analog level sensor • 2: Float switch • 3: Unknown	-
AI, 0	Fault code	R	Grundfos fault code	-
AI, 1	Warning code	R	Grundfos warning code	-

ID	Object Name	R/W	Notes	Units
AI, 2	HighLevel	R	High level in centimetres.	cm
AI, 3	StartLevelPump1	R	Start level for pump 1 in centimetres.	cm
AI, 4	StopLevelPump1	R	Stop level for pump 1 in centimetres.	cm
AI, 5	StartLevelPump2	R	Start level for pump 2 in centimetres.	cm
AI, 6	Pit water level	R	Pit water level in centimetres.	cm
AI, 7	Pit power consumption	R	Pit power consumption in watts.	W
AI, 8	Pit energy consumption	R	Pit energy consumption in kilowatt hours.	kWh
AI, 9	Pit running time	R	Pit running time in minutes.	min
AI, 10	Analog Input 1 (AI1)	R	Analog Input 1	%
AI, 11	Analog Input 2 (AI2)	R	Analog Input 2	%
AI, 12	Analog input 3 (AI3)	R	Analog Input 3	%
AI, 13	Pump1 time to service	R	Pump 1 time to service in minutes.	min
AI, 14	Pump2 time to service	R	Pump 2 time to service in minutes.	min
AI, 15	Pump1 start counter	R	Pump 1 start counter.	-
AI, 16	Pump2 start counter	R	Pump 2 start counter.	-
AI, 17	Pump1 current	R	Pump 1 current in amperes.	A
AI, 18	Pump2 current	R	Pump 2 current in amperes.	A
AI, 19	Pump1 operating time	R	Pump 1 overall operating time in minutes.	min
AI, 20	Pump2 operating time	R	Pump 2 overall operating time in minutes.	min
AI, 21	UserAnalogInput1	R	User-defined measurement, analog input 1.	%
AI, 22	UserAnalogInput2	R	User-defined measurement, analog input 2.	%
AI, 23	UserAnalogInput3	R	User-defined measurement, analog input 3.	%
AI, 24	UserAnalogInput4	R	User-defined measurement, analog input 4.	%
AI, 25	UserAnalogInput5	R	User-defined measurement, analog input 5.	%
AI, 26	Latest operating time pump1	R	Pump 1 latest running time in minutes.	min
AI, 27	Latest operating time pump2	R	Pump 2 latest running time in minutes.	min
AI, 28	Energy consumption pump1	R	Pump 1 energy consumption in kilowatt hours.	kWh
AI, 29	Energy consumption pump2	R	Pump 2 energy consumption in kilowatt hours.	kWh
AI, 30	System Energy today	R	DATA_ENERGY_TODAY reported with 0.1 kWh resolution.	kWh
AI, 31	PulseFlowMeter	R	DATA_PULSE_FLOW_METER	l/s
AI, 32	Turbidity	R	DATA_TURBIDITY reported with 0.1 NTU resolution.	NTU
AI, 33	PhMeasure	R	DATA_PH_MEASURE reported with 0.1 pH resolution.	pH
AI, 34	Conductivity	R	DATA_CONDUCTIVITY reported with 1 S/m resolution.	S/m
AI, 35	Pump1OprTimeToday	R	DATA_PUMP1_RUNTIME_TODAY	min
AI, 36	Pump2OprTimeToday	R	DATA_PUMP2_RUNTIME_TODAY	min
AI, 37	Pump1StartCounterToday	R	DATA_PUMP1_RUNTIME_TODAY	min
AI, 38	Pump2StartCounterToday	R	DATA_PUMP2_RUNTIME_TODAY	min

ID	Object Name	R/W	Notes	Units
AI, 39	Alarms 1-5 and warnings 1-5	R	Values are transmitted in the following order: <ul style="list-style-type: none"> • bit 0: Status warnings1 • bit 1: Status warnings2 • bit 2: Status warnings3 • bit 3: Status warnings4 • bit 4: Status warnings5 • bit 8: Status alarms1 • bit 9: Status alarms2 • bit 10: Status alarms3 • bit 11: Status alarms4 • bit 12: Status alarms5 	-
			Bit values indicate the following: <ul style="list-style-type: none"> • bit value 0: Alarm or warning not present • bit value 1: Alarm or warning present 	
AI, 40	Sensor present status	R	Values are transmitted in the following order: <ul style="list-style-type: none"> • bit 0: Flow sensor present • bit 1: Power/energy sensor present • bit 2: AI sensor 1 present • bit 3: AI sensor 2 present • bit 4: AI sensor 3 present • bit 5: AI sensor 4 present • bit 6: AI sensor 5 present • bit 7: Turbidity sensor present • bit 8: pH sensor present • bit 9: Conductivity sensor present • bit 10: Pulse flow meter present • bit 11: Pressure sensor present • bit 12: Level sensor present 	-
			Bit values indicate the following: <ul style="list-style-type: none"> • bit value 0: Sensor not present • bit value 1: Sensor present 	
BI, 0	AcknowledgeAlarm	R	0: Not acknowledged 1: Acknowledged	-
BI, 1	FloatSwitch1Status	R	0: Off (Float switch down) 1: On (Float switch up)	-
BI, 2	FloatSwitch2Status	R	0: Off (Float switch down) 1: On (Float switch up)	-
BI, 3	FloatSwitch3Status	R	0: Off (Float switch down) 1: On (Float switch up)	-
BI, 4	FloatSwitch4Status	R	0: Off (Float switch down) 1: On (Float switch up)	-
BI, 5	FloatSwitch5Status	R	0: Off (Float switch down) 1: On (Float switch up)	-
BI, 6	Pump1Present	R	0: Not present 1: Present	-
BI, 7	Pump2Present	R	0: Not present 1: Present	-
BI, 8	Pump1Running	R	0: Not running 1: Running	-
BI, 9	Pump2Running	R	0: Not running 1: Running	-

ID	Object Name	R/W	Notes	Units
Bl, 10	Pump1CommFault	R	0: No communication fault 1: Pump or auxiliary device communication fault	-
Bl, 11	Pump2CommFault	R	0: No communication fault 1: Pump or auxiliary device communication fault	-
Bl, 12	Pump1Alarm	R	0: No alarm 1: Alarm	-
Bl, 13	Pump2Alarm	R	0: No alarm 1: Alarm	-
Bl, 14	Pump1Warning	R	0: No warning 1: Warning	-
Bl, 15	Pump2Warning	R	0: No warning 1: Warning	-
Bl, 16	Pump1Disabled	R	0: Enabled 1: Disabled (Out of operation)	-
Bl, 17	Pump2Disabled	R	0: Enabled 1: Disabled (Out of operation)	-
Bl, 34	Acknowledge ResetEventLogAlarm	R	0: Not Acknowledged 1: Acknowledged	-
Bl, 35	Control Status	R	0: Auto control 1: Manual control	-

Argentina

Bombas GRUNDFOS de Argentina S.A.
Ruta Panamericana km. 37.500 Centro
Industrial Garin
1619 Garin Pcia. de B.A.
Phone: +54-3327 414 444
Telefax: +54-3327 45 3190

Australia

GRUNDFOS Pumps Pty. Ltd.
P.O. Box 2040
Regency Park
South Australia 5942
Phone: +61-8-8461-4611
Telefax: +61-8-8340 0155

Austria

GRUNDFOS Pumpen Vertrieb
Ges.m.b.H.
Grundfosstraße 2
A-5082 Grödig/Salzburg
Tel.: +43-6246-883-0
Telefax: +43-6246-883-30

Belgium

N.V. GRUNDFOS Bellux S.A.
Boomsesteenweg 81-83
B-2630 Aartselaar
Tel.: +32-3-870 7300
Télécopie: +32-3-870 7301

Belarus

Представительство ГРУНДФОС в
Минске
220125, Минск
ул. Шафарнянская, 11, оф. 56, БЦ
«Порт»
Тел.: +375 17 397 397 3
+375 17 397 397 4
Факс: +375 17 397 397 1
E-mail: minsk@grundfos.com

Bosnia and Herzegovina

GRUNDFOS Sarajevo
Zmaja od Bosne 7-7A,
BH-71000 Sarajevo
Phone: +387 33 592 480
Telefax: +387 33 590 465
www.ba.grundfos.com
e-mail: grundfos@bih.net.ba

Brazil

BOMBAS GRUNDFOS DO BRASIL
Av. Humberto de Alencar Castelo
Branco, 630
CEP 09850 - 300
São Bernardo do Campo - SP
Phone: +55-11 4393 5533
Telefax: +55-11 4343 5015

Bulgaria

Grundfos Bulgaria EOOD
Slatina District
Iztocna Tangenta street no. 100
BG - 1592 Sofia
Tel. +359 2 49 22 200
Fax. +359 2 49 22 201
email: bulgaria@grundfos.bg

Canada

GRUNDFOS Canada Inc.
2941 Brighton Road
Oakville, Ontario
L6H 6C9
Phone: +1-905 829 9533
Telefax: +1-905 829 9512

China

GRUNDFOS Pumps (Shanghai) Co. Ltd.
10F The Hub, No. 33 Suhong Road
Minhang District
Shanghai 201106
PRC
Phone: +86 21 612 252 22
Telefax: +86 21 612 253 33

COLOMBIA

GRUNDFOS Colombia S.A.S.
Km 1.5 vía Siberia-Cota Conj. Potrero
Chico,
Parque Empresarial Arcos de Cota Bod.
1A.
Cota, Cundinamarca
Phone: +57(1)-2913444
Telefax: +57(1)-8764586

Croatia

GRUNDFOS CROATIA d.o.o.
Buzinski prilaz 38, Buzin
HR-10010 Zagreb
Phone: +385 1 6595 400
Telefax: +385 1 6595 499
www.hr.grundfos.com

GRUNDFOS Sales Czechia and Slovakia s.r.o.

Čajkovského 21
779 00 Olomouc
Phone: +420-585-716 111

Denmark

GRUNDFOS DK A/S
Martin Bachs Vej 3
DK-8850 Bjerringbro
Tlf.: +45-87 50 50 50
Telefax: +45-87 50 51 51
E-mail: info_GDK@grundfos.com
www.grundfos.com/DK

Estonia

GRUNDFOS Pumps Eesti OÜ
Peterburi tee 92G
11415 Tallinn
Tel: + 372 606 1690
Fax: + 372 606 1691

Finland

OY GRUNDFOS Pumput AB
Trukkikuja 1
FI-01360 Vantaa
Phone: +358-(0) 207 889 500

France

Pompes GRUNDFOS Distribution S.A.
Parc d'Activités de Chesnes
57, rue de Malacombe
F-38290 St. Quentin Fallavier (Lyon)
Tél.: +33-4 74 82 15 15
Télécopie: +33-4 74 94 10 51

Germany

GRUNDFOS GMBH
Schlüterstr. 33
40699 Erkrath
Tel.: +49-(0) 211 929 69-0
Telefax: +49-(0) 211 929 69-3799
e-mail: infoservice@grundfos.de
Service in Deutschland:
e-mail: kundendienst@grundfos.de

Greece

GRUNDFOS Hellas A.E.B.E.
20th km. Athinon-Markopoulou Av.
P.O. Box 71
GR-19002 Peania
Phone: +0030-210-66 83 400
Telefax: +0030-210-66 46 273

Hong Kong

GRUNDFOS Pumps (Hong Kong) Ltd.
Unit 1, Ground floor
Siu Wai Industrial Centre
29-33 Wing Hong Street &
68 King Lam Street, Cheung Sha Wan
Kowloon
Phone: +852-27861706 / 27861741
Telefax: +852-27858664

Hungary

GRUNDFOS Hungária Kft.
Tópark u. 8
H-2045 Törökbálint,
Phone: +36-23 511 110
Telefax: +36-23 511 111

India

GRUNDFOS Pumps India Private
Limited
118 Old Mahabalipuram Road
Thoraipakkam
Chennai 600 096
Phone: +91-44 2496 6800

Indonesia

PT. GRUNDFOS POMPA
Graha Intirub Lt. 2 & 3
Jln. Cililitan Besar No.454. Makasar,
Jakarta Timur
ID-Jakarta 13650
Phone: +62 21-469-51900
Telefax: +62 21-460 6910 / 460 6901

Ireland

GRUNDFOS (Ireland) Ltd.
Unit A, Merrywell Business Park
Ballymount Road Lower
Dublin 12
Phone: +353-1-4089 800
Telefax: +353-1-4089 830

Italy

GRUNDFOS Pompe Italia S.r.l.
Via Gran Sasso 4
I-20060 Truccazzano (Milano)
Tel.: +39-02-95838112
Telefax: +39-02-95309290 / 95838461

Japan

GRUNDFOS Pumps K.K.
1-2-3, Shin-Miyakoda, Kita-ku,
Hamamatsu
431-2103 Japan
Phone: +81 53 428 4760
Telefax: +81 53 428 5005

Korea

GRUNDFOS Pumps Korea Ltd.
6th Floor, Aju Building 679-5
Yeoksam-dong, Kangnam-ku, 135-916
Seoul, Korea
Phone: +82-2-5317 600
Telefax: +82-2-5633 725

Latvia

SIA GRUNDFOS Pumps Latvia
Deglava biznesa centrs
Augusta Deglava iela 60, LV-1035, Rīga,
Tālr.: + 371 714 9640, 7 149 641
Fakss: + 371 914 9646

Lithuania

GRUNDFOS Pumps UAB
Smolensko g. 6
LT-03201 Vilnius
Tel: + 370 52 395 430
Fax: + 370 52 395 431

Malaysia

GRUNDFOS Pumps Sdn. Bhd.
7 Jalan Peguam U1/25
Glenmarie Industrial Park
40150 Shah Alam
Selangor
Phone: +60-3-5569 2922
Telefax: +60-3-5569 2866

Mexico

Bombas GRUNDFOS de México S.A. de C.V.
Boulevard TLC No. 15
Parque Industrial Stiva Aeropuerto
Apodaca, N.L. 66600
Phone: +52-81-8144 4000
Telefax: +52-81-8144 4010

Netherlands

GRUNDFOS Netherlands
Veluwezoom 35
1326 AE Almere
Postbus 22015
1302 CA ALMERE
Tel.: +31-88-478 6336
Telefax: +31-88-478 6332
E-mail: info_gnl@grundfos.com

New Zealand

GRUNDFOS Pumps NZ Ltd.
17 Beatrice Tinsley Crescent
North Harbour Industrial Estate
Albany, Auckland
Phone: +64-9-415 3240
Telefax: +64-9-415 3250

Norway

GRUNDFOS Pumper A/S
Strømsveien 344
Postboks 235, Leirdal
N-1011 Oslo
Tlf.: +47-22 90 47 00
Telefax: +47-22 32 21 50

Poland

GRUNDFOS Pompy Sp. z o.o.
ul. Klonowa 23
Baranowo k. Poznania
PL-62-081 Przeźmierowo
Tel: (+48-61) 650 13 00
Fax: (+48-61) 650 13 50

Portugal

Bombas GRUNDFOS Portugal, S.A.
Rua Calvet de Magalhães, 241
Apartado 1079
P-2770-153 Paço de Arcos
Tel.: +351-21-440 76 00
Telefax: +351-21-440 76 90

Romania

GRUNDFOS Pompe România SRL
Bd. Biruintei, nr 103
Pantelimon county Ilfov
Phone: +40 21 200 4100
Telefax: +40 21 200 4101
E-mail: romanian@grundfos.ro

Russia

ООО Грундфос Россия
ул. Школьная, 39-41
Москва, RU-109544, Russia
Тел. (+7) 495 564-88-00 (495) 737-30-00
Факс (+7) 495 564 8811
E-mail grundfos.moscow@grundfos.com

Serbia

Grundfos Srbija d.o.o.
Omladinskih brigada 90b
11070 Novi Beograd
Phone: +381 11 2258 740
Telefax: +381 11 2281 769
www.rs.grundfos.com

Singapore

GRUNDFOS (Singapore) Pte. Ltd.
25 Jalan Tukang
Singapore 619264
Phone: +65-6681 9688
Telefax: +65-6681 9689

Slovakia

GRUNDFOS s.r.o.
Prievozská 4D
821 09 BRATISLAVA
Phona: +421 2 5020 1426
sk.grundfos.com

Slovenia

GRUNDFOS LJUBLJANA, d.o.o.
Leskoškova 9e, 1122 Ljubljana
Phone: +386 (0) 1 568 06 10
Telefax: +386 (0) 1 568 06 19
E-mail: tehnika-si@grundfos.com

South Africa

Grundfos (PTY) Ltd.
16 Lascelles Drive, Meadowbrook Estate
1609 Germiston, Johannesburg
Tel.: (+27) 10 248 6000
Fax: (+27) 10 248 6002
E-mail: lgradidge@grundfos.com

Spain

Bombas GRUNDFOS España S.A.
Camino de la Fuentecilla, s/n
E-28110 Algete (Madrid)
Tel.: +34-91-848 8800
Telefax: +34-91-628 0465

Sweden

GRUNDFOS AB
Box 333 (Lunnagårdsgatan 6)
431 24 Mölndal
Tel.: +46 31 332 23 000
Telefax: +46 31 331 94 60

Switzerland

GRUNDFOS Pumpen AG
Bruggacherstrasse 10
CH-8117 Fällanden/ZH
Tel.: +41-44-806 8111
Telefax: +41-44-806 8115

Taiwan

GRUNDFOS Pumps (Taiwan) Ltd.
7 Floor, 219 Min-Chuan Road
Taichung, Taiwan, R.O.C.
Phone: +886-4-2305 0868
Telefax: +886-4-2305 0878

Thailand

GRUNDFOS (Thailand) Ltd.
92 Chaloe Phrakiat Rama 9 Road,
Dokmai, Pravej, Bangkok 10250
Phone: +66-2-725 8999
Telefax: +66-2-725 8998

Turkey

GRUNDFOS POMPA San. ve Tic. Ltd. Sti.
Gebze Organize Sanayi Bölgesi
İhsan dede Caddesi,
2. yol 200. Sokak No. 204
41490 Gebze/ Kocaeli
Phone: +90 - 262-679 7979
Telefax: +90 - 262-679 7905
E-mail: satis@grundfos.com

Ukraine

Бізнес Центр Європа
Столичне шосе, 103
м. Київ, 03131, Україна
Телефон: (+38 044) 237 04 00
Факс.: (+38 044) 237 04 01
E-mail: ukraine@grundfos.com

United Arab Emirates

GRUNDFOS Gulf Distribution
P.O. Box 16768
Jebel Ali Free Zone
Dubai
Phone: +971 4 8815 166
Telefax: +971 4 8815 136

United Kingdom

GRUNDFOS Pumps Ltd.
Grovebury Road
Leighton Buzzard/Beds. LU7 4TL
Phone: +44-1525-850000
Telefax: +44-1525-850011

U.S.A.

GRUNDFOS Pumps Corporation
9300 Loiret Blvd.
Lenexa, Kansas 66219
Phone: +1-913-227-3400
Telefax: +1-913-227-3500

Uzbekistan

Grundfos Tashkent, Uzbekistan The Representative Office of Grundfos Kazakhstan in Uzbekistan
38a, Oybek street, Tashkent
Телефон: (+998) 71 150 3290 / 71 150 3291
Факс: (+998) 71 150 3292

Addresses Revised 31.03.2020

98690071 0420
ECM: 1281926

Trademarks displayed in this material, including but not limited to Grundfos, the Grundfos logo and "be think innovate" are registered trademarks owned by The Grundfos Group. All rights reserved.
© 2020 Grundfos Holding A/S, all rights reserved.